

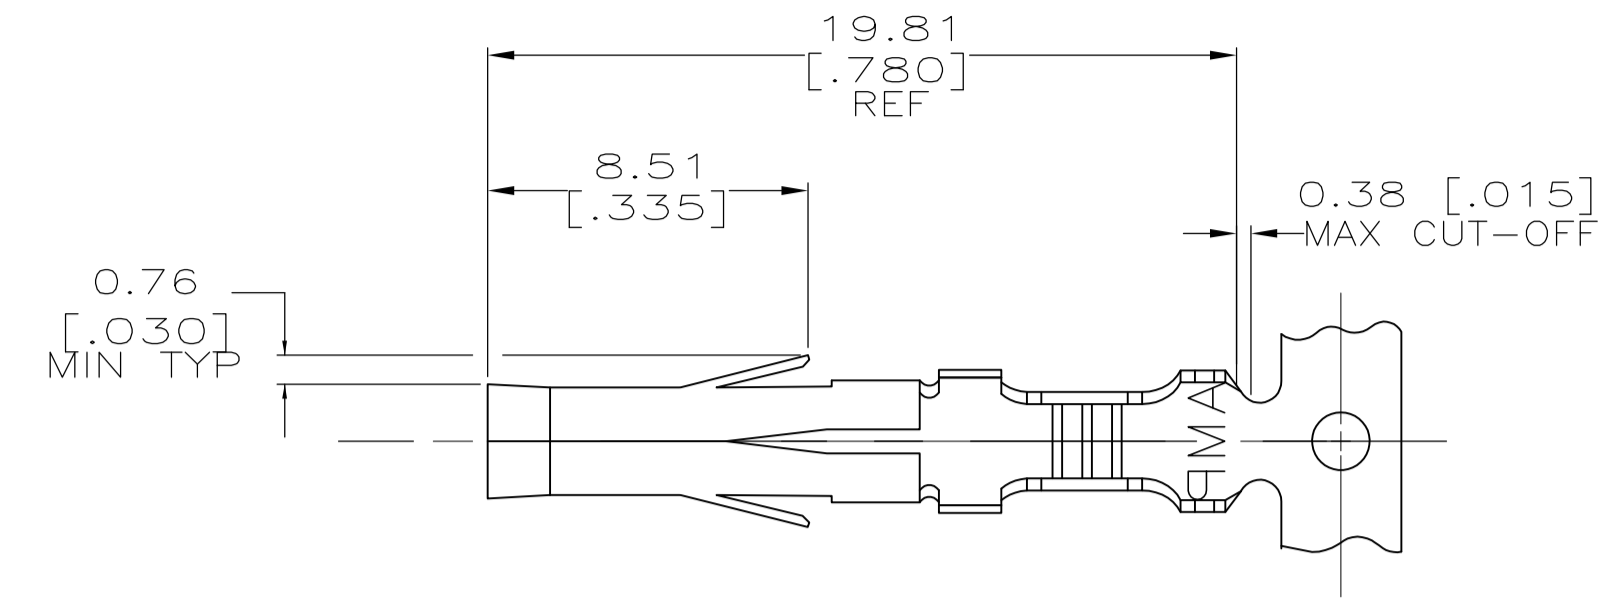
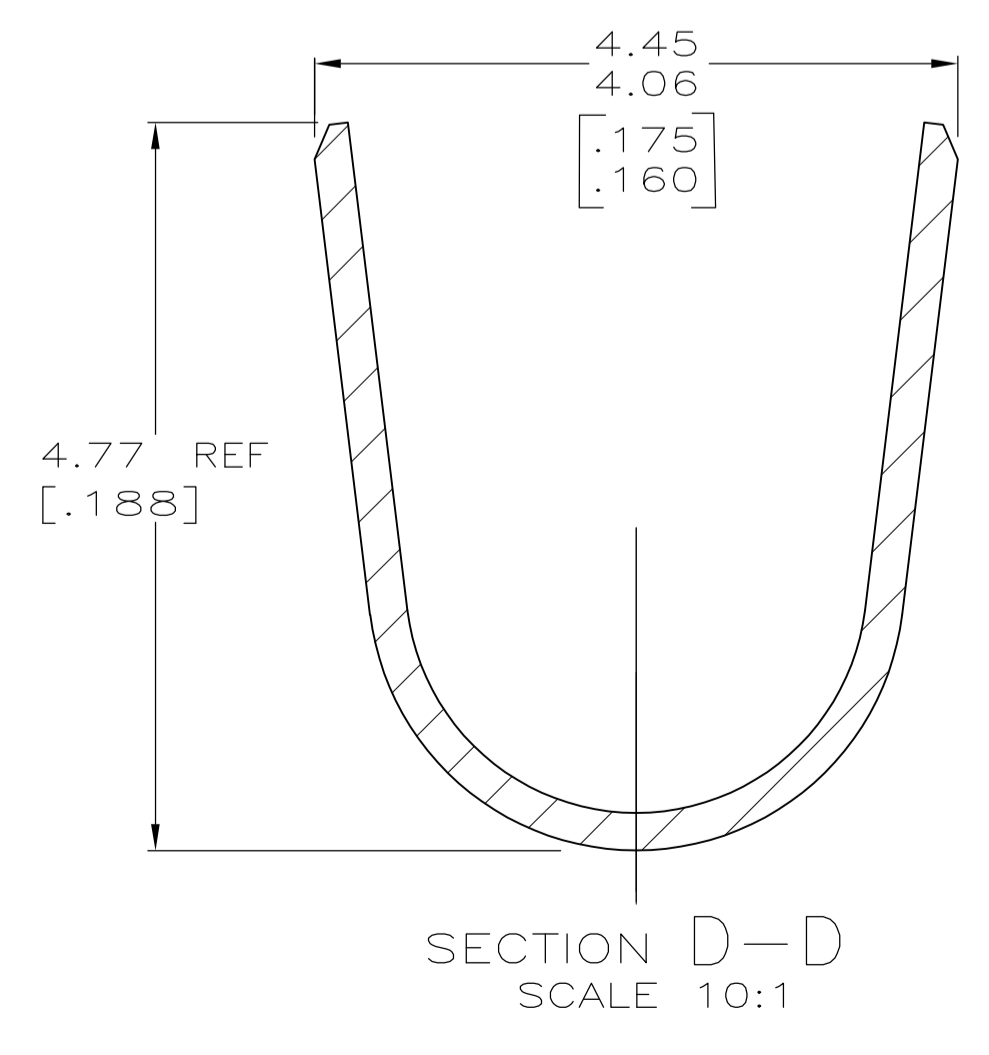
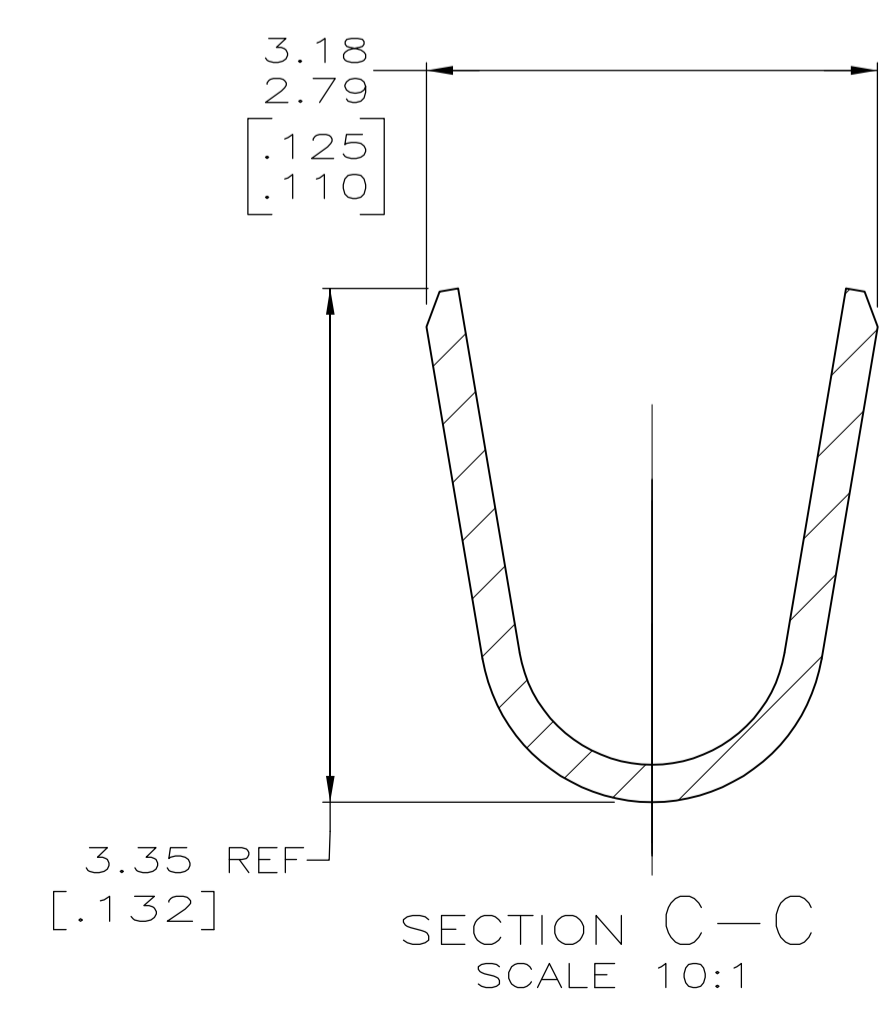
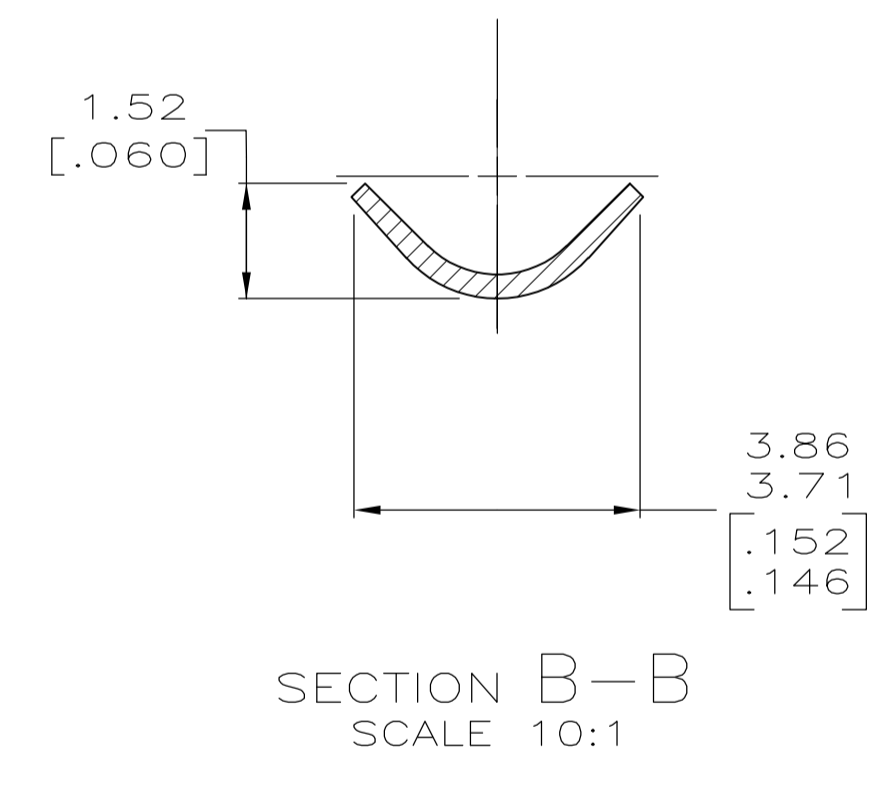
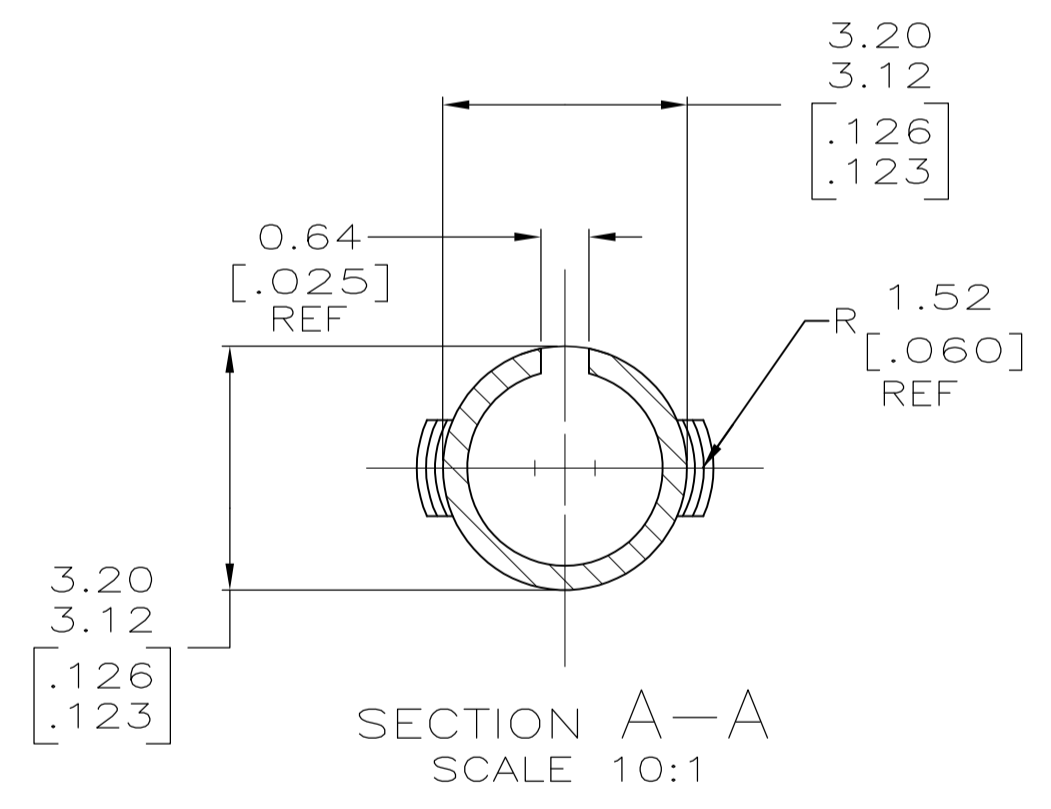


LOC		DIST		REVISIONS			
P	LTR	DESCRIPTION	DATE	DN	APVD		
AL2		REVISED PER ECR-18-002042	09FEB2018	BDA	JB		

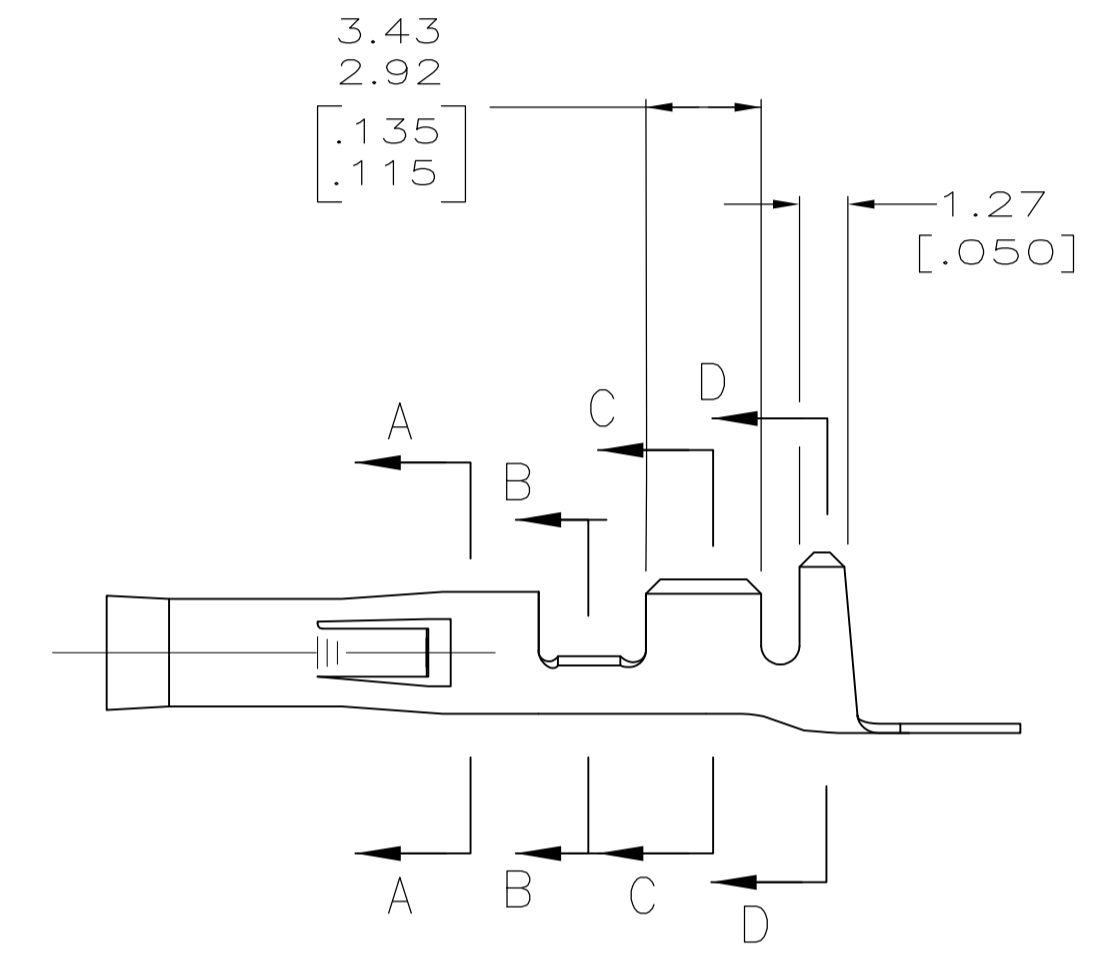

- 1 WIRE RANGE: 0.5-2mm² (20-14 AWG).
- 2 INSULATION RANGE: 3.56 [.140] MAX. DIA.
- 3 DIMENSIONS IN BRACKETS ARE IN INCHES.
- 4 0.00076 [.000030] MIN GOLD STRIPE OVER 0.00127 [.000050] MIN NICKEL ON INSIDE OF SOCKET.
- 5 .00127 [.000050] MIN NICKEL

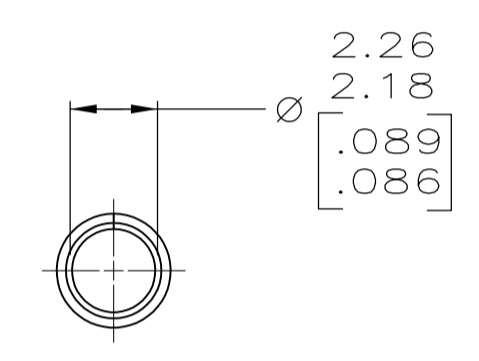

勝特力電材超市-龍山店 886-3-5773766
 勝特力電材超市-光復店 886-3-5729570
 勝特力电子(上海) 86-21-34970699
 勝特力电子(深圳) 86-755-83298787
<http://www.100y.com.tw>

PRELIMINARY PART NUMBER NOT IN PRODUCTION	FINISH	MATERIAL	PART NO
5	PRE-TIN	0.25 [.010] PHOS BRZ	350415-8
		0.25 [.010] PHOS BRZ	350415-6
4	PRE-TIN	0.25 [.010] BRASS	350415-5
		0.25 [.010] BRASS	350415-1

THIS DRAWING IS A CONTROLLED DOCUMENT.		DIN K WHITAKER 22NOV2005		TE Connectivity	
DIMENSIONS: mm [INCHES]		CHK D COLEY 22NOV2005			
TOLERANCES UNLESS OTHERWISE SPECIFIED:		APVD D COLEY 22NOV2005		NAME .093 SOCKET	
0 PLC ± -		PRODUCT SPEC		COMMERCIAL PIN AND SOCKET	
1 PLC ± -		APPLICATION SPEC		-	
2 PLC ± -		SIZE		A1	
3 PLC ± 0.13 [.005]		CAGE CODE		00779	
4 PLC ± -		DRAWING NO		350415	
ANGLES ± 0°30'		WEIGHT		-	
MATERIAL SEE TABLE		FINISH SEE TABLE		CUSTOMER DRAWING	
		SCALE		5:1	
		SHEET		1 OF 1	
		REV		AL2	

NOTE



All numerical values are in metric units [with U.S. customary units in brackets]. Dimensions are in millimeters [and inches]. Unless otherwise specified, dimensions have a tolerance of ± 0.13 [$\pm .005$] and angles have a tolerance of $\pm 2^\circ$. Figures and illustrations are for identification only and are not drawn to scale.

1. INTRODUCTION

This specification covers the requirements for application of .093 Diameter Pin and Socket Contacts and Housings. These requirements are applicable automatic machine crimping tools.

When corresponding with TE Connectivity (TE) Personnel, use the terminology provided on this specification to help facilitate your inquiry for information. Basic terms and features of components are provided in Figure 1.

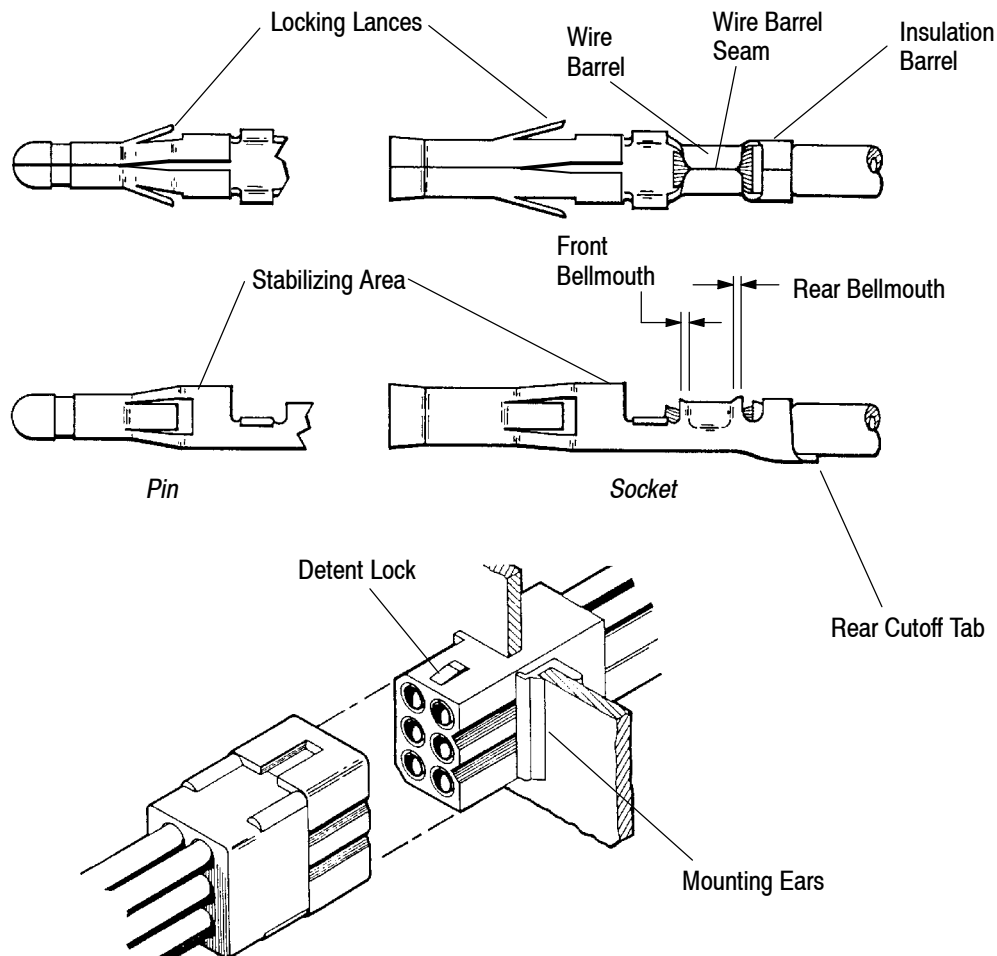


Figure 1

2. REFERENCE MATERIAL

2.1. Revision Summary

- Updated document to corporate requirements
- New logo

2.2. Customer Assistance

Reference Part Number 350415 and Product Code 2090 are representative numbers of the .093 Diameter product line. Use of these numbers will identify the product line and expedite your inquiries through a service network established to help you obtain product and tooling information. Such information can be obtained through a local TE Representative or, after purchase, by calling the Tooling Assistance Center or the Product Information numbers at the bottom of page 1.

2.3. Drawings

Customer Drawings for specific products are available from the responsible Engineering department via the service network. The information contained in the Customer Drawings takes priority if there is a conflict with this specification or with any other technical documentation supplied by TE.

2.4. Specifications

Product Specification 108-1038 provides applicable performance requirements for the contacts.

2.5. Instruction Material

Instruction material for automatic and hand application tooling is shipped with the appropriate tooling. Refer to Figure 2 for referenced documents.

3. REQUIREMENTS

3.1. Wire Preparation

A. Wire Selection

The contacts will accept stranded wire ranging in size from 14 to 24 AWG. Wire insulation diameter shall have minimum and maximum dimensions according to the wire sizes indicated in Figure 2.

B. Wire Preparation

The wire strip length shall be as indicated in Figure 2. Reasonable care shall be taken during the stripping operation to ensure the conductor is not nicked, scraped, or cut.

3.2. Crimped Contacts

Contacts shall be crimped in accordance with the material packaged with the tooling; refer to Figure 2.

A. Carrier Cutoff Tab

Cutoff tab shall not exceed .38 [.015].

HAND TOOL WIRE CRIMP DIMENSIONS

WIRE		WIRE BARREL			INSULATION BARREL CRIMP WIDTH	HAND TOOL PART NUMBER● (Instruction Sheet)
SIZE (AWG)	INSULATION DIAMETER (Max.)	STRIP LENGTH ±0.38 [.015]	CRIMP HEIGHT ±0.05 [.002]	CRIMP WIDTH		
20	3.56 [.140]	4.34 [.171]	1.07 [.042]	2.29 [.090]	3.30 [.130]	90871-1 (408-9966)
18			1.07 [.042]			
16			1.45 [.057]			
14			1.45 [.057]			
24	2.79 [.110]	4.34 [.171]	0.81 [.032]	1.78 [.070]	3.05 [.120]	90872-1 (408-9967)
22			0.81 [.032]			
20			1.02 [.040]			
18			1.02 [.040]			

● Use dash 1 (-1) and dash 3 (-3) for a "T" type machine and dash 2 (-2) and dash 4 (-4) for a "K" type machine.

Figure 2 (cont'd)

AUTOMATIC MACHINE WIRE CRIMP DIMENSIONS

WIRE			WIRE BARREL		INSULATION BARREL CRIMP WIDTH	APPLICATOR PART NUMBER● (Instruction Sheet)
SIZE (AWG)	INSULATION DIAMETER (Max.)	STRIP LENGTH ±0.38 [.015]	CRIMP HEIGHT ±0.05 [.002]	CRIMP WIDTH		
20	3.56 [.140]	4.34 [.171]	1.09 [.043]	2.29 [.090]	3.30 [.130]	466878-1, -2 (408-8040)
18			1.22 [.048]			
16			1.40 [.055]			
14			1.68 [.066]			
24	2.79 [.110]	4.34 [.171]	0.89 [.035]	1.78 [.070]	3.05 [.120]	466656-1, -2 (408-8040)
22			0.94 [.037]			
20			0.99 [.039]			
18			1.14 [.045]			
18	4.57 [.180]	6.35 [.250]	1.40 [.055]	2.29 [.090]	4.57 [.180]	567273-2 (408-8040)
18 (2)	4.57 [.180] Each		1.68 [.066]			
16	4.57 [.180]		1.57 [.062]			
14			1.85 [.073]			
20	4.57 [.180]	4.34 [.171]	1.09 [.043]	2.29 [.090]	3.94 [.155]	567337-3, -4 (408-8040)
18			1.22 [.048]			
16			1.40 [.055]			
14			1.68 [.066]			

Figure 2 (end)

B. Wire Barrel Crimp Inspection

1. Crimp height and width shall be as shown in Figure 2.
2. The wire barrel seam shall be closed adequately to confine all strands of the wire. There shall be no loose wire strands. Wire strands should not be embedded in the seam of the wire barrel.
3. The rear bellmouth shall be .13-.76 [.005-.030]. The front bellmouth shall be 0.38 [.015] maximum.
4. The end of the wire shall be flush with the front end of the wire barrel, or extend 1.02 [.040] maximum. Both insulation and conductor shall be visible between the insulation barrel and wire barrel. Care shall be taken not to allow insulation to be crimped in the wire barrel.
5. Wire barrel flash shall not exceed 0.25 [.010].

C. Insulation Barrel Crimp Inspection

1. Crimp width shall be as shown in Figure 2.
2. Care shall be taken not to cut or break the insulation during the crimping operation.

D. Locking Lances

The locking lances shall not be deformed.

E. Alignment

The crimped insulation barrel shall fall into an area defined by a 4.06 [.160] diameter circle. Crimped contacts with two wires shall fall into a 5.21 x 9.78 [.205 x .385] area. Crimped contacts using 4.57 [.180] insulation diameter should fall into a 4.44 [.175] diameter circle. See Figure 3.

There shall be no twist or roll in the crimped portion that will impair usage of the contact.

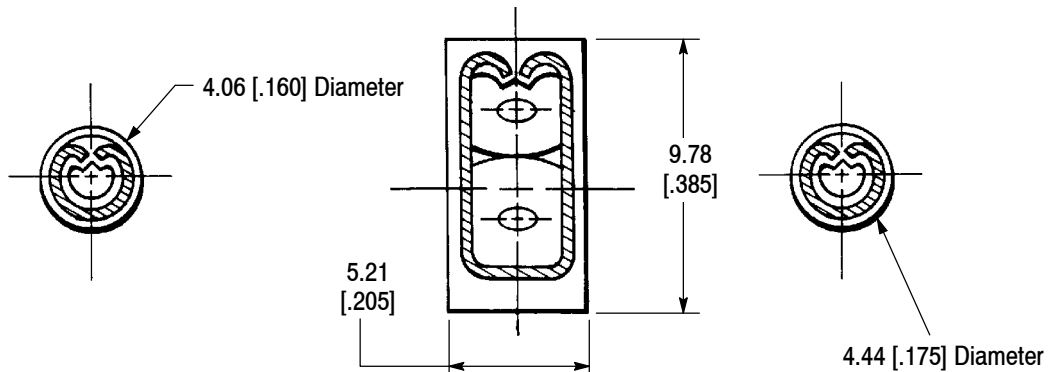



Figure 3

3.3. Housings

Housings are available in receptacle and plug versions. Receptacles are available with mounting ears and detents or with detent only. Plugs are available with or without mounting ears. Housings are available in 1 through 15 positions and have a standard 5.03 [.198] centerline. They are also available with a 6.35 [.250] centerline.

3.4. Panel-Mounting Cutouts

Panel-mounting cutouts shall be as indicated in Figure 4.

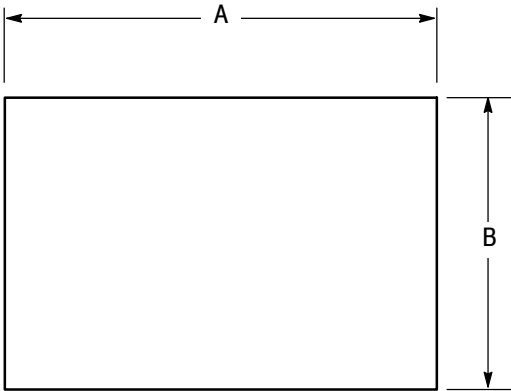 Recommended Panel Cutout	NUMBER OF CIRCUIT POSITIONS	DIMENSIONS†			
		RECEPTACLE		PLUG	
		A	B	A	B
	2	18.42 [.725]	7.92 [.312]	20.32 [.800]	9.52 [.375]
	3	21.34 [.840]	7.92 [.312]	23.70 [.933]	9.52 [.375]
	3 (6.35 [.250] CTR)	23.37 [.920]	7.87 [.310]	25.96 [1.022]	9.27 [.365]
	4 (6.35 [.250] CTR)	29.67 [1.168]	7.87 [.310]	32.26 [1.270]	9.27 [.365]
	4 IN-LINE	26.37 [1.038]	7.92 [.312]	28.73 [1.131]	9.52 [.375]
	6	18.24 [.718]	15.24 [.600]	19.05 [.750]	17.65 [.695]
	6 (6.35 [.250] CTR)	24.03 [.946]	15.44 [.608]	26.62 [1.048]	16.71 [.658]
	9	21.03 [.828]	18.42 [.725]	23.80 [.937]	16.76 [.660]
	12	26.67 [1.050]	18.42 [.725]●	29.34 [1.155]	19.30 [.760]
	15	31.50 [1.240]	16.64 [.655]	34.11 [1.343]	19.30 [.760]

† Tolerance of 0.25 [.010].
● Use 16.64 [.655] if using housing without detents.

Figure 4

3.5. Repair


Connectors can be repaired by removing the contact from the housing and making the repair. When extracting a contact, the lances should be reset to their original position. Consult the customer print for the correct setting. See Section 5 for tooling.

4. QUALIFICATION


The .093 Diameter Housings are Recognized by Underwriters' Laboratories, Inc. in UL File number E28476 and CSA International Certified in File number LR7189.

5. TOOLING (Figure 5)


The .093 Diameter Contacts are terminated by automatic machine or hand crimping tools. Figure 2 lists tooling used for crimping these contacts. Use Insertion Tool 91002 (408-7347) to insert crimped pin and socket contacts in housing. Use Extraction Tool 458994-3 (408-9923) to remove pin and socket contacts from the housing.

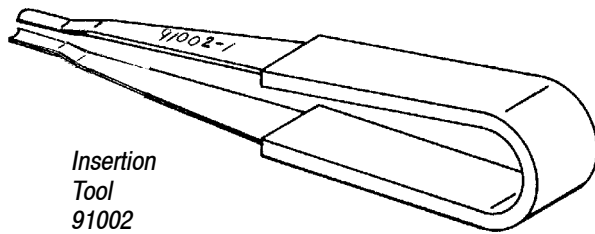

Insertion
Tool
91002

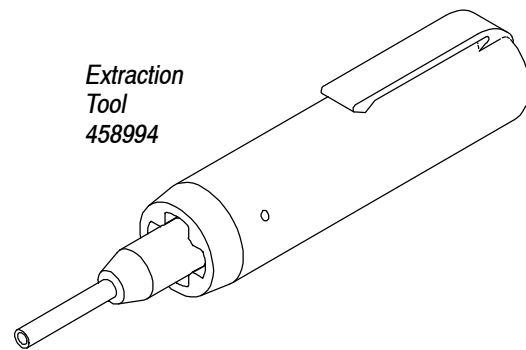

Extraction
Tool
458994

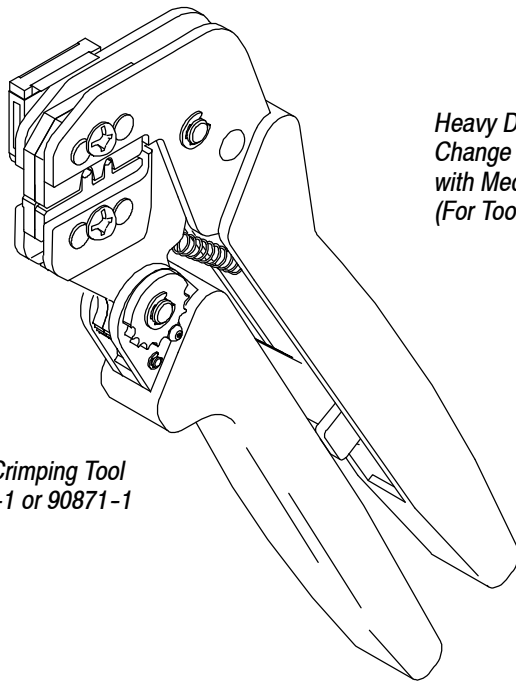

Hand Crimping Tool
90872-1 or 90871-1

Heavy Duty Miniature Quick
Change Applicator (Side-Feed Type)
with Mechanical Feed System
(For Tooling Part Numbers, See Figure 2)

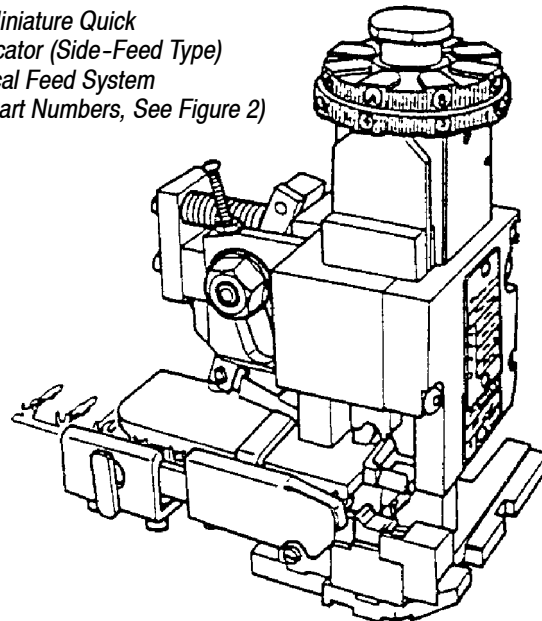


Figure 5

6. VISUAL AID

The following illustrations are to be used by production personnel to ensure properly applied product. The views suggest requirements for good applications. Applications considered visually incorrect should be inspected using the information in the main body of this document.

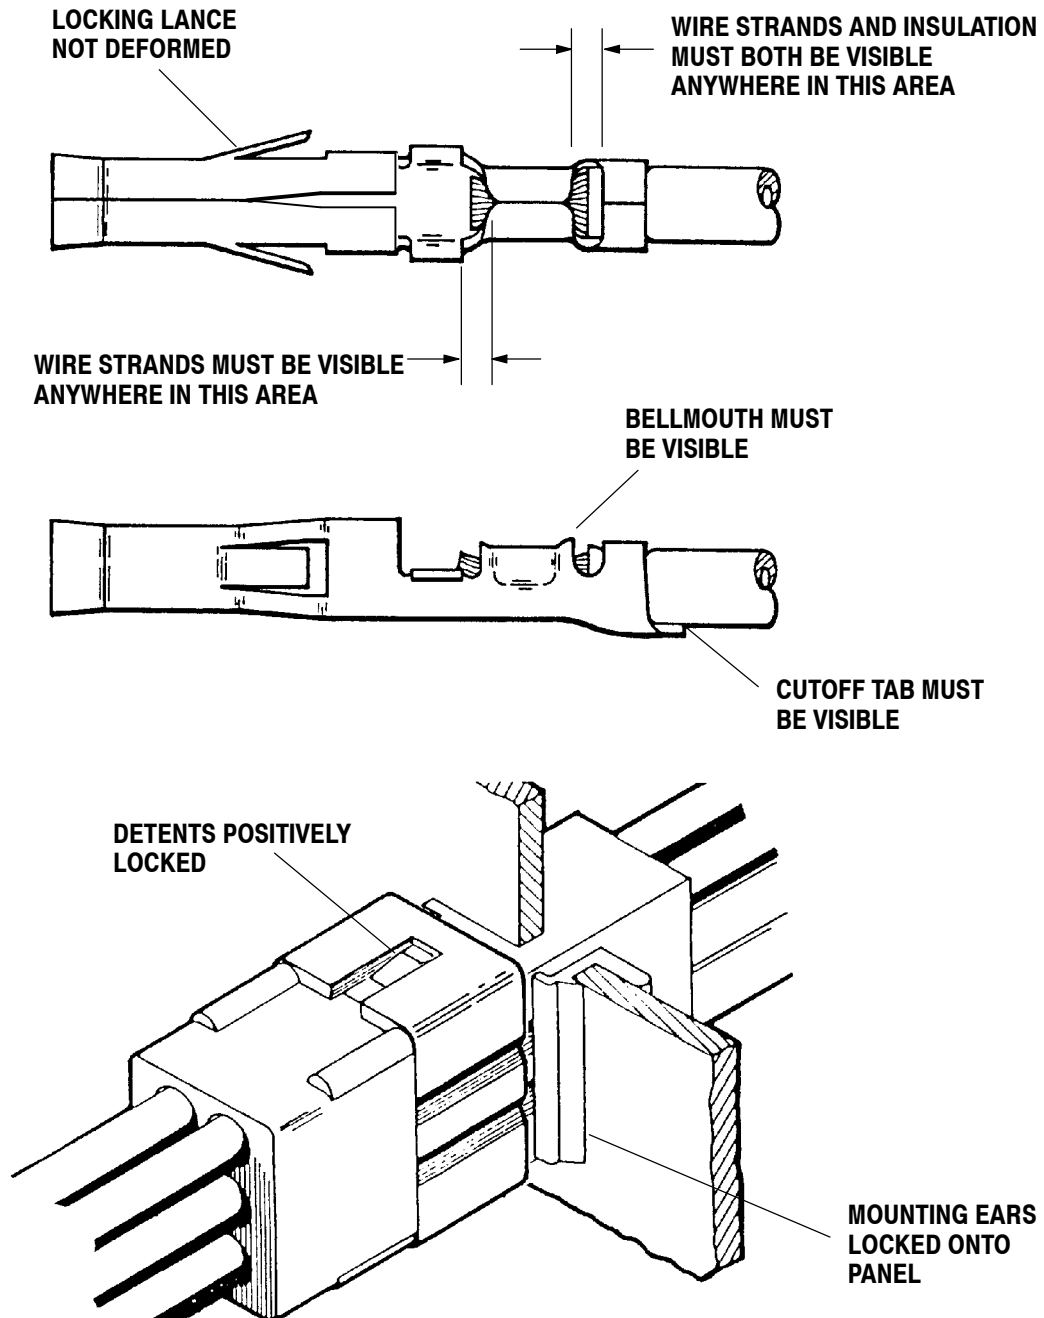


FIGURE 6. VISUAL AID